




~~実機~~
予想 **ポンプ性能曲線図**

No. TW45NS371-6.3

客先	殿			製造番号	---	試験者	---
名称	自吸式ハヤシリークレスポンプ	型式	HDG-405NS	試験日	- 年 - 月 - 日	試験液	---
仕様	m ×	L/min	口径	φ 50 × φ 40 mm	動力	3 相 2 P 3.7 kW 60 Hz	

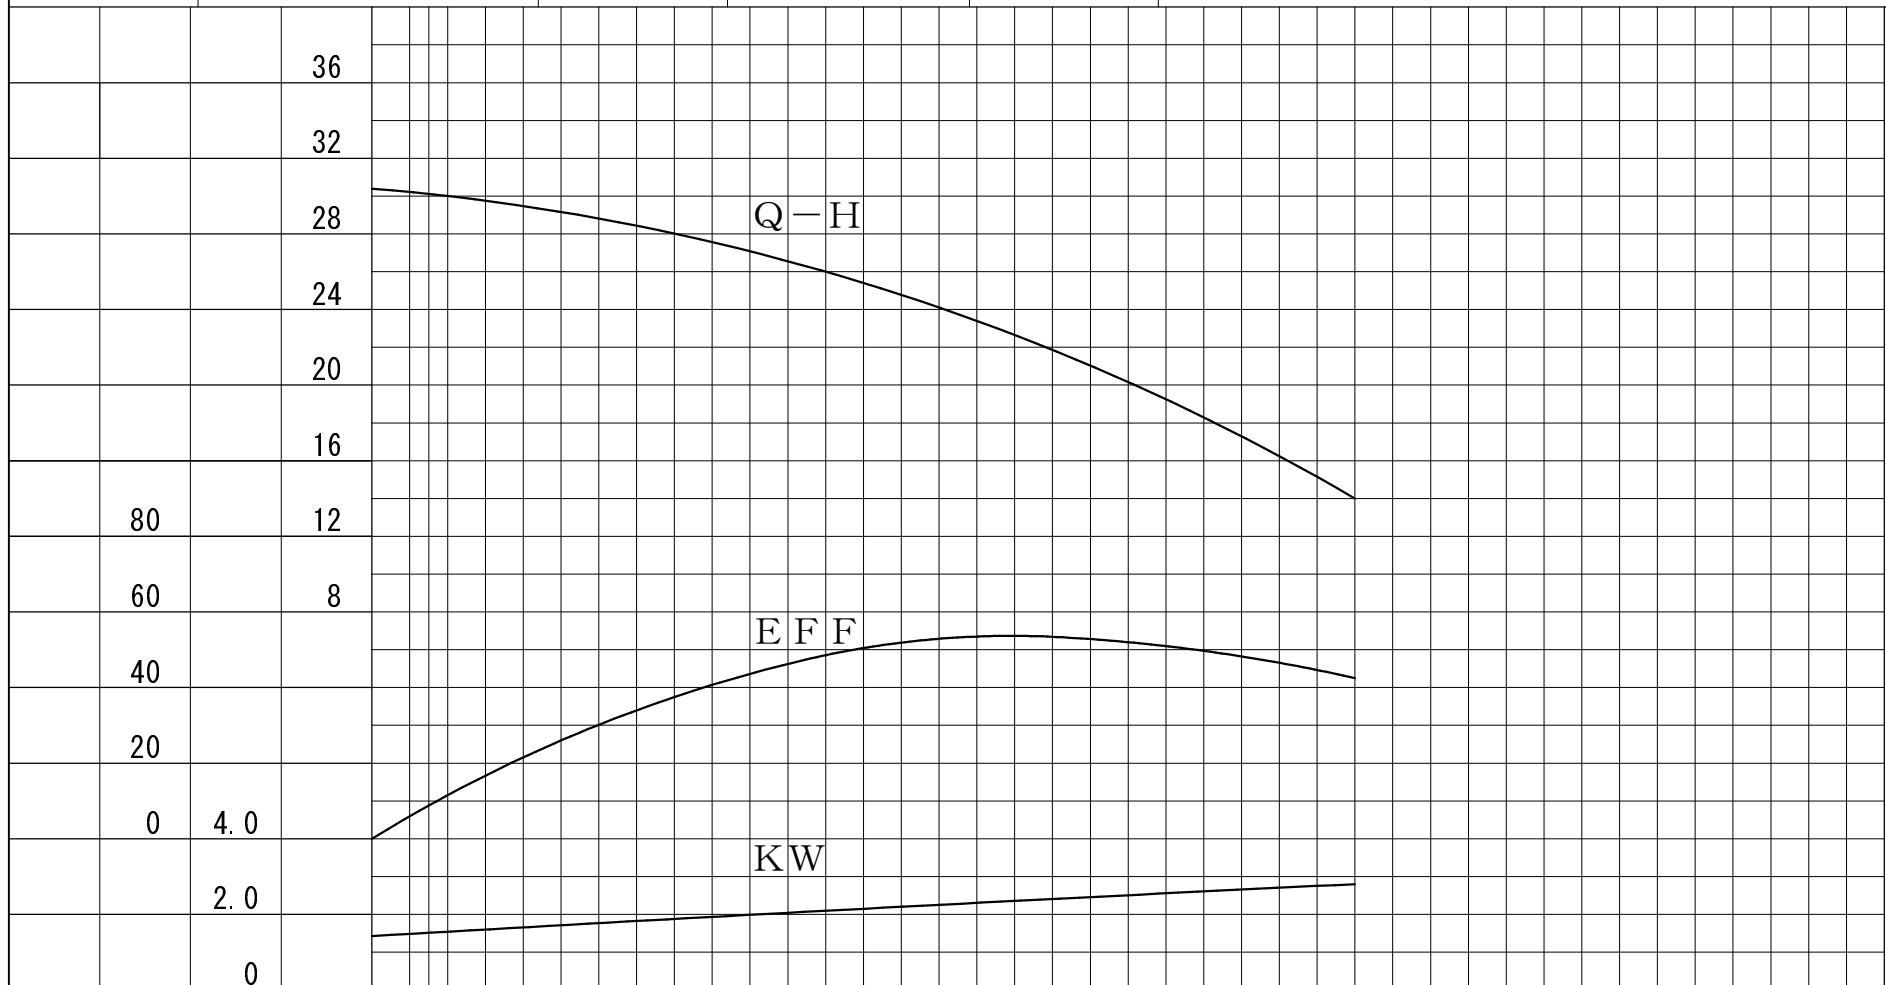

R. P. M 回転数 (min ⁻¹)	E. F. F 効率 (%)	KW 動力 (kW)	H 全揚程 (m)	<div style="display: flex; justify-content: space-between;"> 30 100 200 300 400 500 600 </div> <hr/> <div style="display: flex; justify-content: space-between;"> Q 吐出量(L/min) (備考) 比重 : 1.3 </div> <hr/> <div style="display: flex; justify-content: space-between;"> 最少吐出量 : 30L/min </div>
--	----------------------	------------------	-----------------	---